


Operation and Service Guide: Showers

P.O. Box 309 • Menomonee Falls, WI 53052-0309 1.800.BRADLEY • Fax: 262.251.5817 • bradleycorp.com

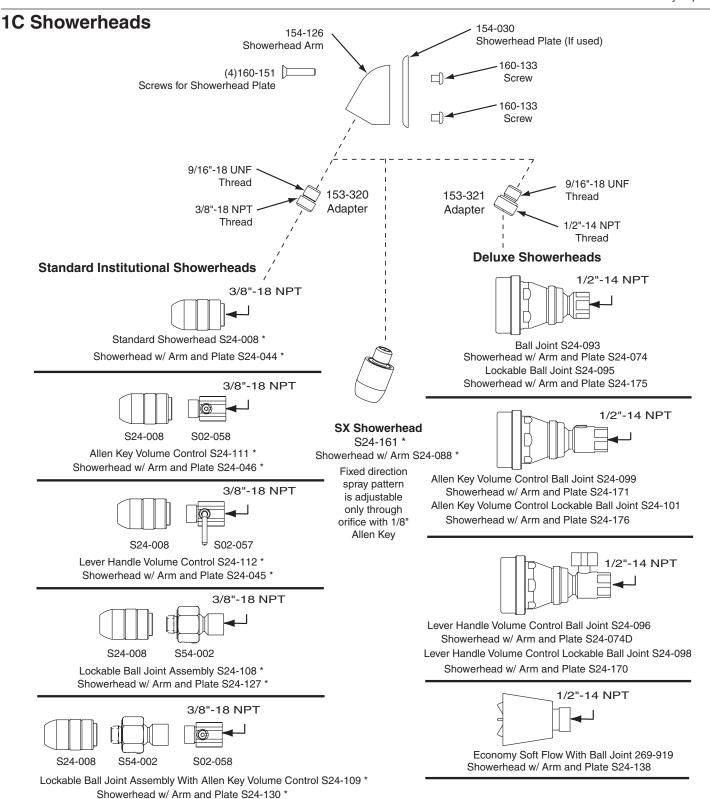

* Add suffix G for 1.5 GPM Flow Restrictor (Example: S24-044G)

3/8"-18 NPT

S02-057

S24-008

S54-002